

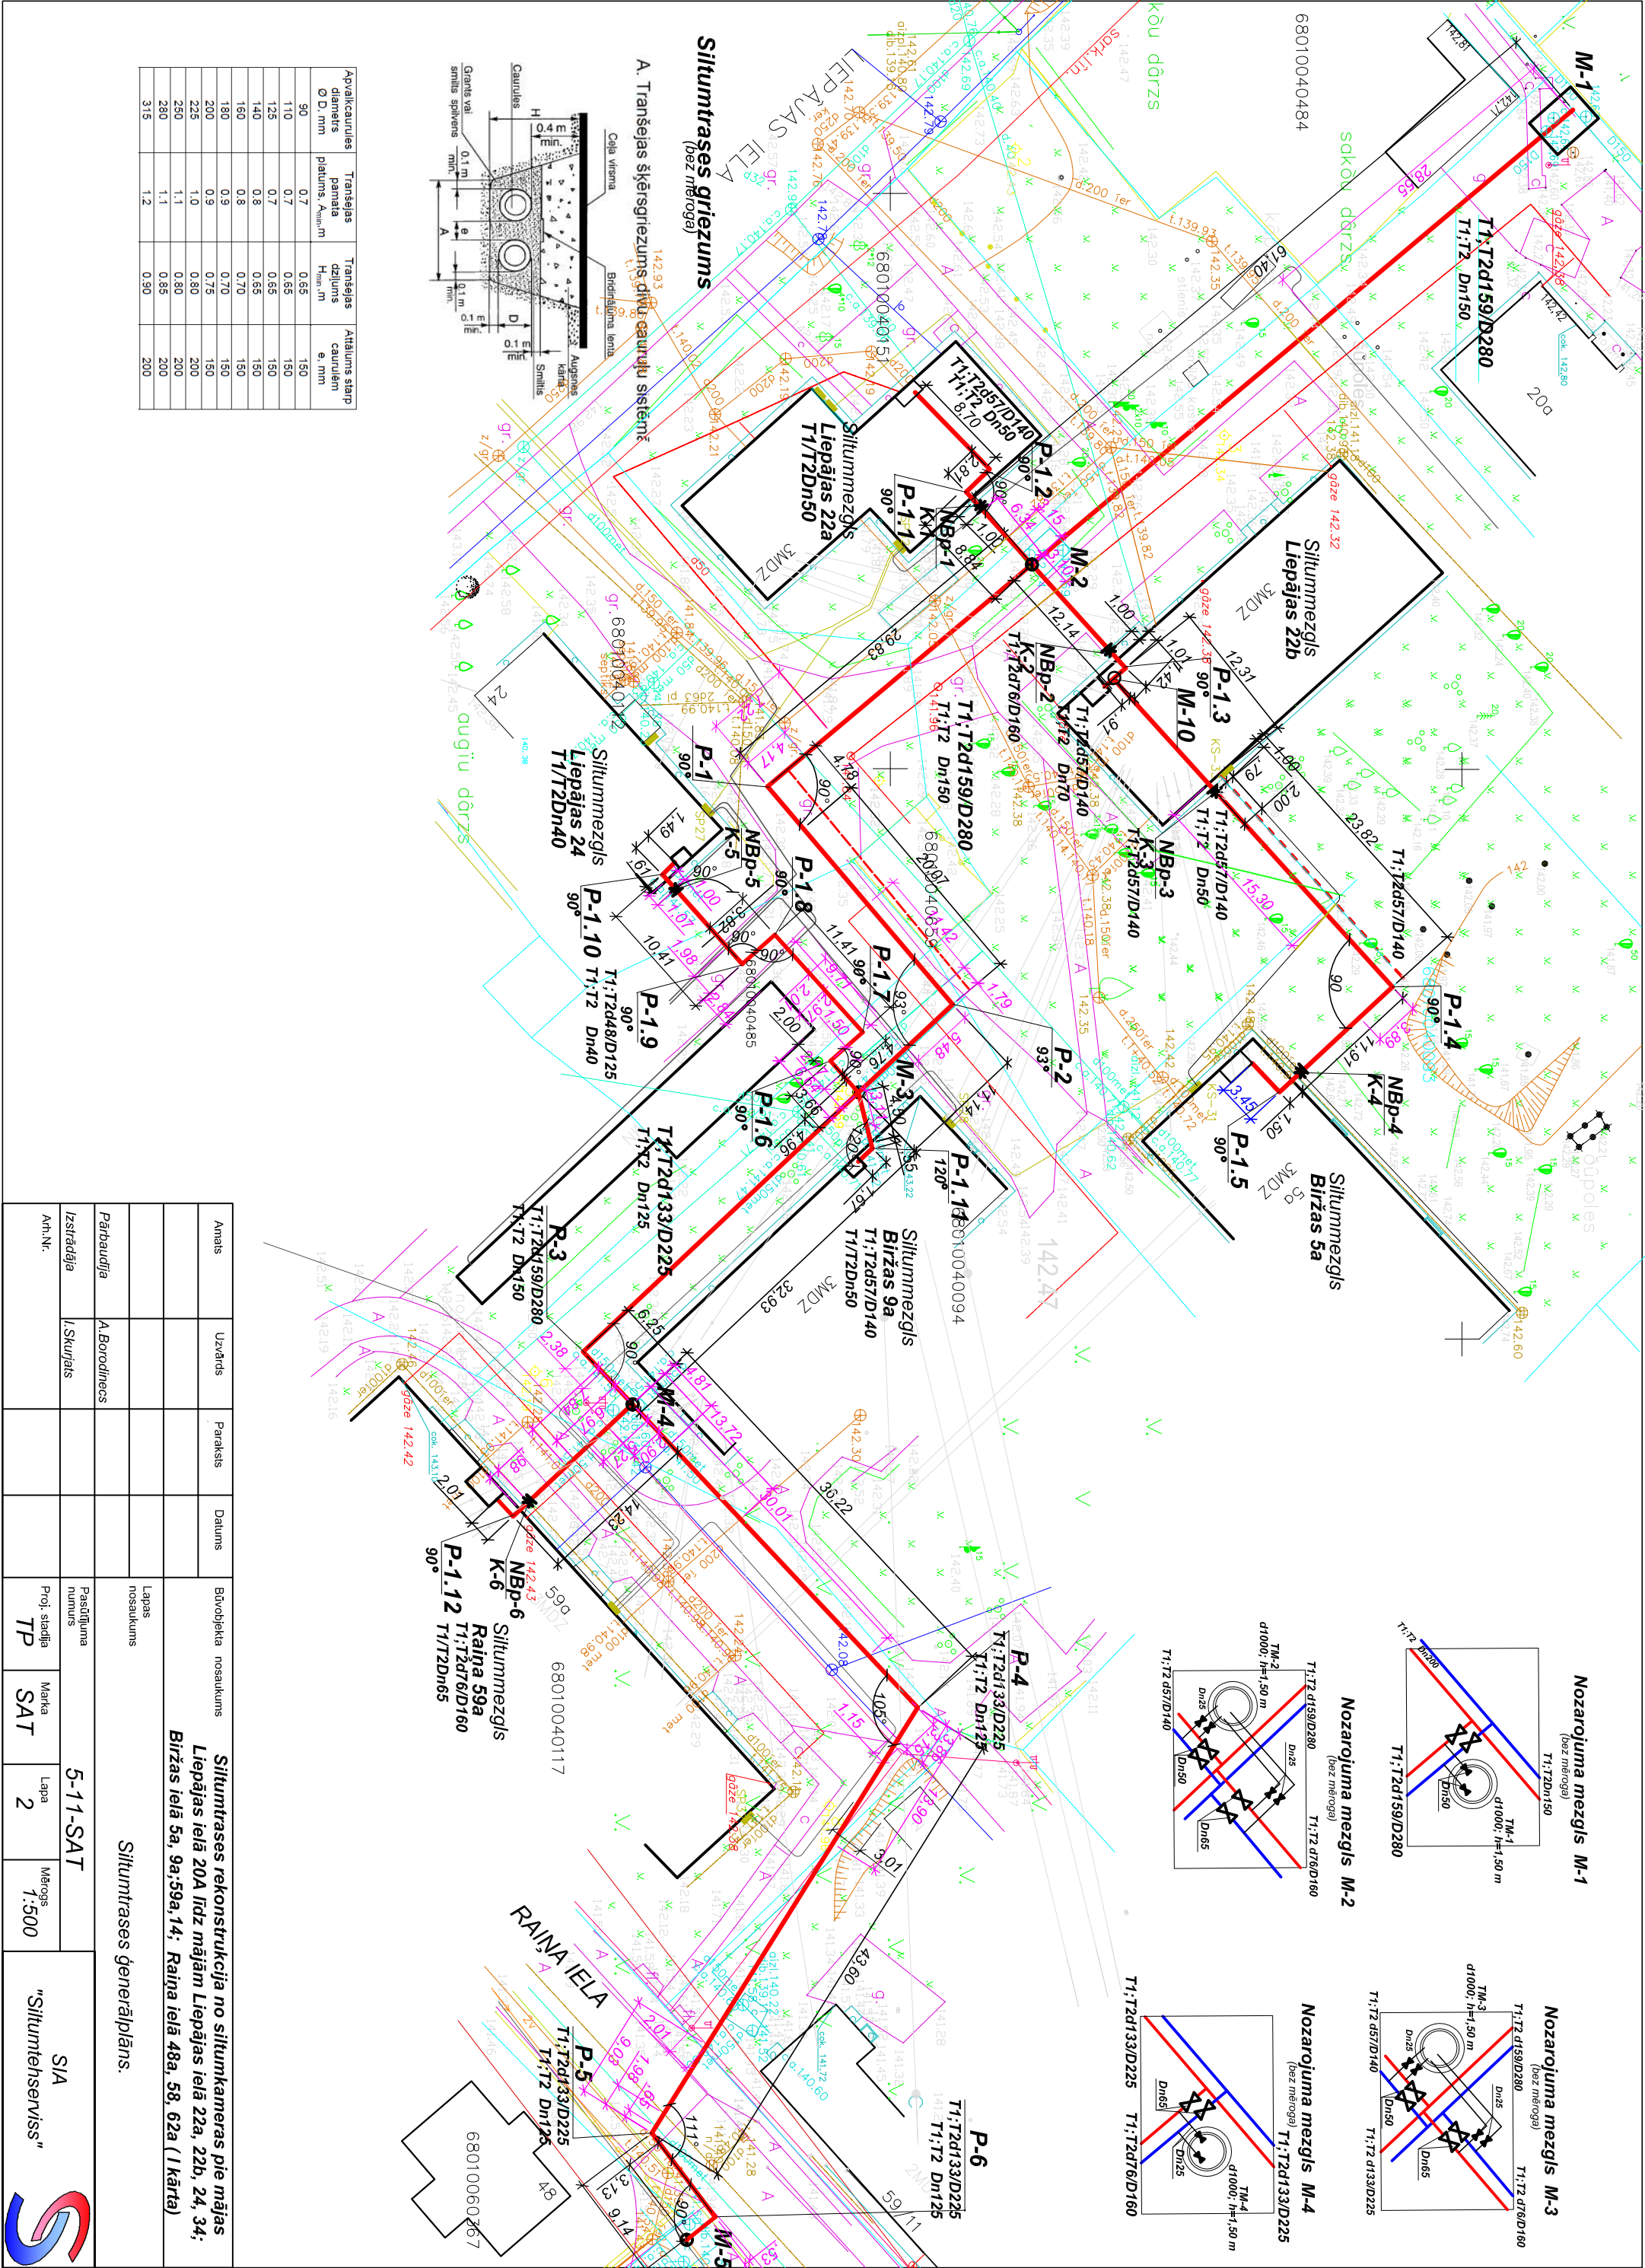
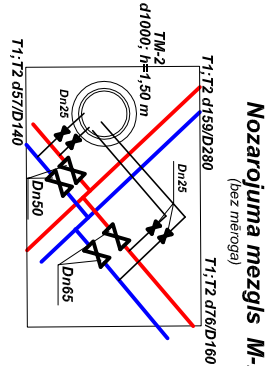
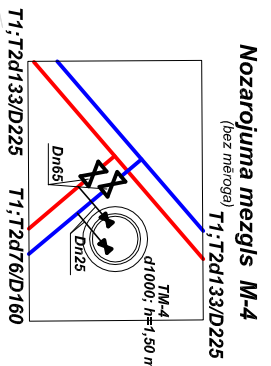


Apvalkcaurules diametrs Ø D, mm	Transšejas pamats platums, A _{min} , m	Transšejas dziļums H _{min} , m	Attālums starp e, mm
90	0.7	0.65	150
110	0.7	0.65	150
125	0.7	0.65	150
140	0.8	0.65	150
160	0.8	0.70	150
180	0.9	0.75	150
200	0.9	0.80	200
225	1.0	0.80	200
280	1.1	0.85	200
315	1.2	0.90	200

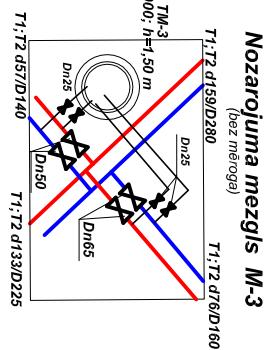

Amats	Uzvārds	Paraksts	Datums	Būvobjekta nosaukums	Siltumtases rekonsrukcija pie mājas Liepājas ielā 20A līdz mājām Liepājas ielā 22a, 22b, 24, 34; Birzas ielā 5a, 9a, 59a, 14; Raina ielā 48a, 58, 62a (1.kārta)			
				Lapas nosaukums	Siltumtases ģenerālpilāns.			
Parbaudīja	A. Borodinecs			Pasūtījuma numurs	5-11-SAT			
Izstrādāja	I. Skurjats			Proj. standja	TP	SAT	Lapa 2	Mērogs 1:500
Ah.Nr.								SIA "Siltumtehserviss"

